


PAR31MAA Remove 4°C Heating Offset




1. Turn controller using Button

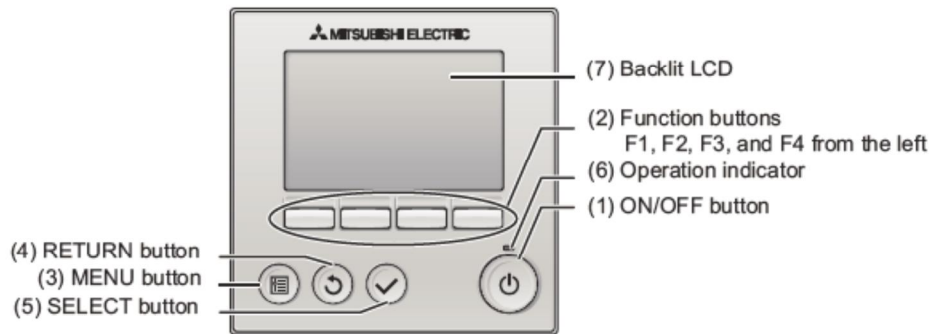


2. Select Menu using Button



3. Select Service menu using down cursor key (F1)

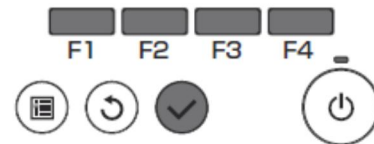

4. Enter maintenance password default 9999 using (F1,F2,F3,F4 keys)

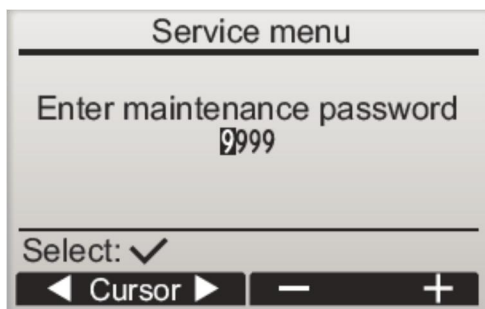

WELLINGTON HEAD OFFICE

1 Parliament Street, Lower Hutt
PO Box 30772, Lower Hutt 5040
Phone (04) 560 9147 · Fax (04) 560 9133

AUCKLAND LOCAL OFFICE

Unit 1, 4 Walls Road, Penrose, Auckland
PO Box 12726, Penrose, Auckland 1642
Phone (09) 526 9347 · Fax (09) 526 9369

CHRISTCHURCH LOCAL OFFICE

44 Halwyn Drive, Hornby, Christchurch
PO Box 16904, Hornby, Christchurch 8441
Phone (03) 341 2837 · Fax (03) 341 2838




5. Press key to acknowledge.

6. Select Function Setting (F1 and F2)


7. Select "0" for Refrigerant Address (F1 and F2) (Different if group controlled)

8. Select "All" for Unit Number using F1 to F4 keys (F3 and F4)

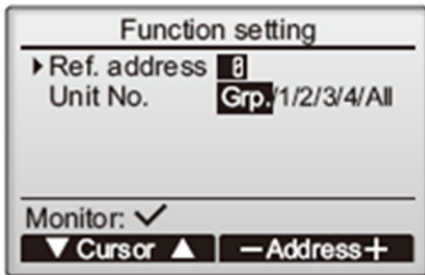

9. Press key and controller will collect data.

10. Select **Mode 24** with up/down keys (F1 and F2)

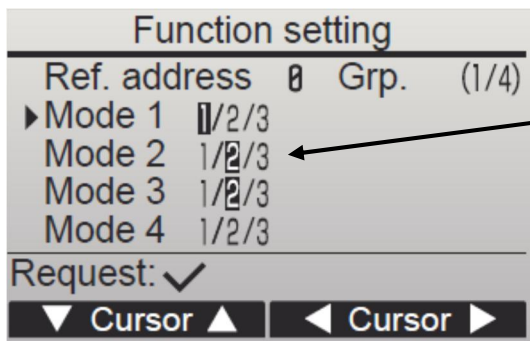

Mode **24** Option **2** selects controller sensor

11. Select **Option 2** with side to side cursor keys (F3 and F4)



12. Press Select Button and controller will send settings to the indoor unit.



13. Exit Function Setting mode with key.



14. Return to normal controller mode with key.

To prove that the 4°C offset has been removed change the controller from heating mode to cooling mode and wait for 30 seconds.

If the 4°C offset is enabled the room temperature display will jump 4°C higher. (For example, if reading 20°C on heating, it will jump to 24°C when switched to cooling).

If the offset is disabled the room temperature display will stay the same. (For example, if reading 20°C on heating it will remain at 20°C when switched to cooling).
