

Water-cooled Chilling Units

The new **e-series** Water-cooled Chilling Units

Refrigerants
R32



The new **e-series** Water-cooled Chilling Units


This new e-series provides a comfortable and energy-conservative air-conditioning system through daily operations.



With growing concerns about global warming, building owners are expected to choose more energy-efficient equipment.

Mitsubishi Electric's chillers have been used widely in various applications from commercial buildings to industrial use.

Besides air-cooled chillers, we have now developed new water-cooled e-series, which is an inverter-driven and uniquely designed modular compact chiller.

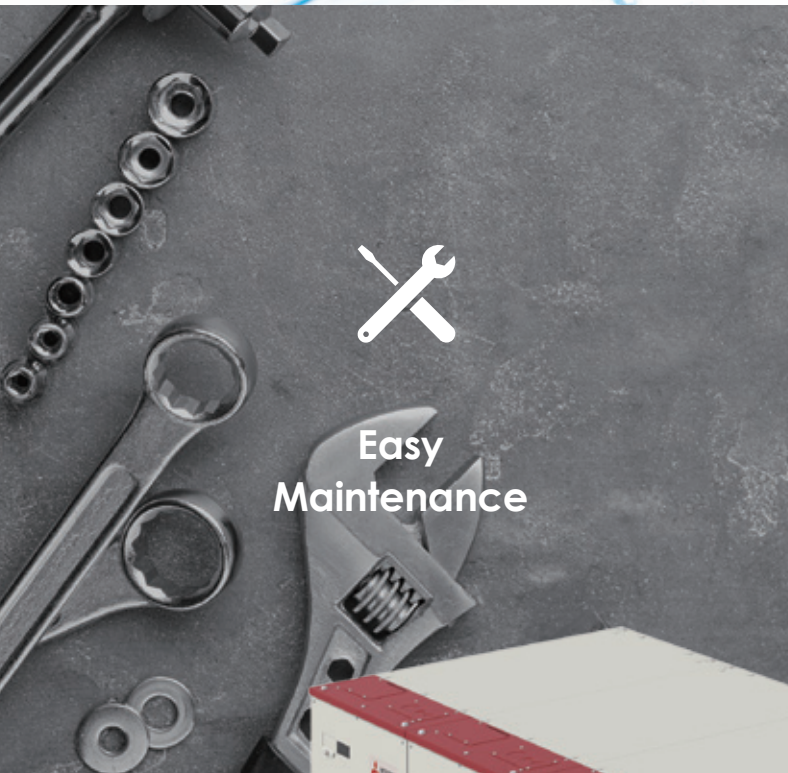

Easy
Maintenance



Energy
Efficiency



High functionality of modular compact chillers

Easy Installation and Highly Efficient Operation

Its compactness contributes to easy carry-in with an elevator.

The use of low GWP refrigerant R32 achieves reduced impact on the environment.

The internal elements can be pulled out improving the ease of maintenance.

The unit can accomplish highly efficient operations (EER: 5.05/SEER: 7.66).

* Values differ when using brine



Compactness & Easy Installation





Thanks to its compact chassis, elevator carry-in is achievable, resulting in an easy installation and shorter construction period.

*Use an elevator that fulfills at least 800 mm for its door and 1,350 mm for its depth.

*A unit can be carried in through a 800 mm wide machine room door.

Compact Chassis

ERCV-M900YA
30HP 90kW

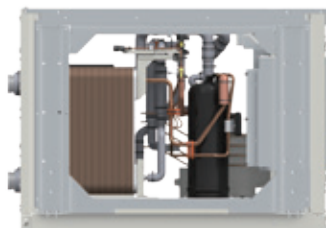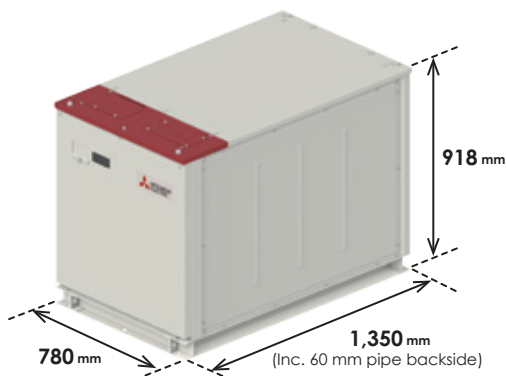



▲ Side view of the structure



▲ Carried in easily with an elevator*
*By an elevator for more than 11 people



Elevator size examples

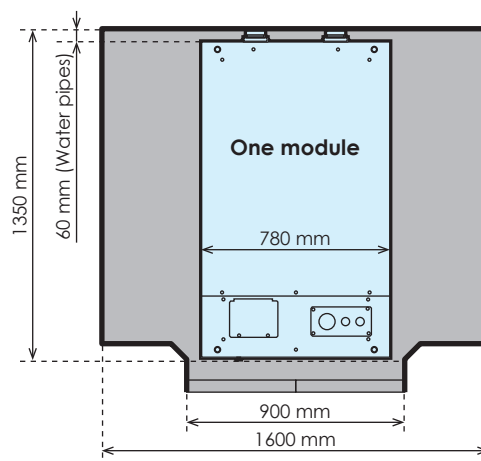
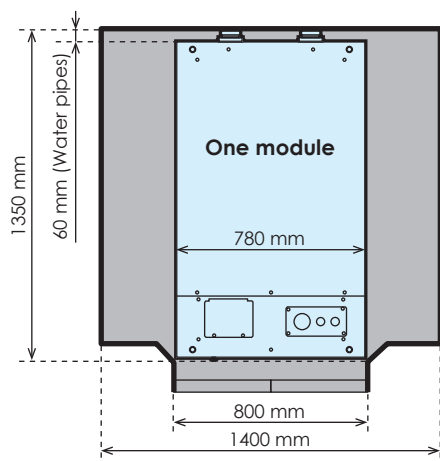


Double stack style

ERCV-M900YA x 2
60HP 180kW

With the top-bottom unit joining kit (ER-01RK)*, two units can be combined vertically and achieve 60 HP/180 kW. Moreover, a maximum of 1,080 kW is possible since up to 6 double-stack units (12 units) are connectable in one group.

* Please refer to the Installation Manual.

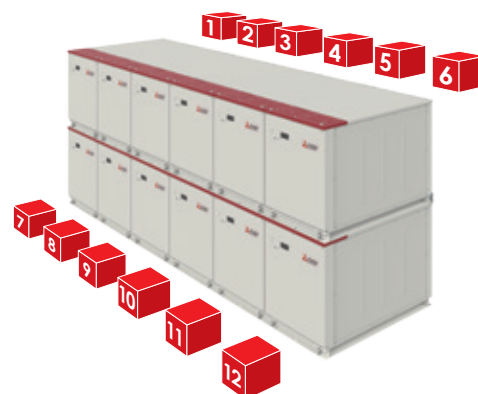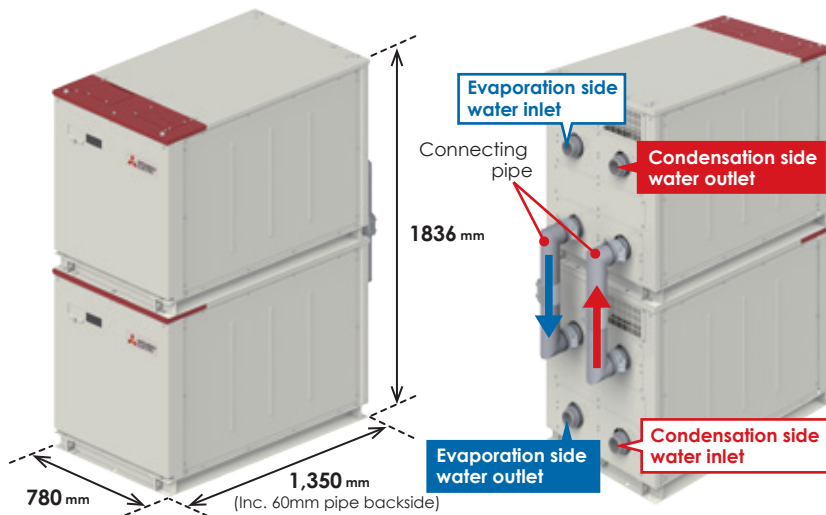


▲ Up to 24 double-stack units can be connected to 1 identical water system.

Low GWP Refrigerant R32



Compared to R410A, the refrigerant that has been generally used for chilling units, R32 has a one-third lower GWP of 675*. Moreover, since R32 is a high-density refrigerant, the refrigerant volume required for a unit is smaller than R410A. The amount of CO₂ emission is calculated based on GWP x refrigerant volume, so the use of R32 has a reduced impact on the environment.

* Source: IPCC 4th Assessment Report, global warming potential (GWP) 100-year value.

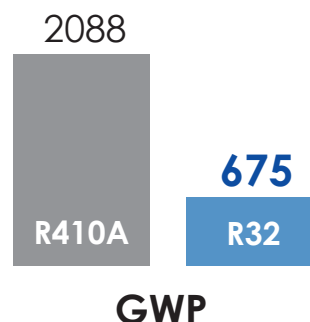


Easy Maintenance




Thanks to the openable and drawable internal structure, this unit provides easy access to each component. When you only want to access the control box, drawing all the components out is unnecessary because it is openable to the front.

Internal Components

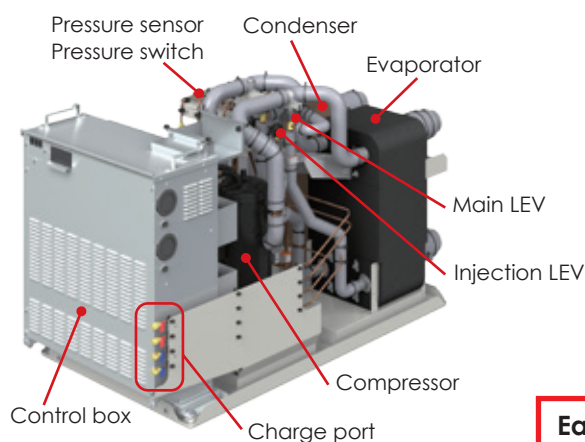


Openable Structure

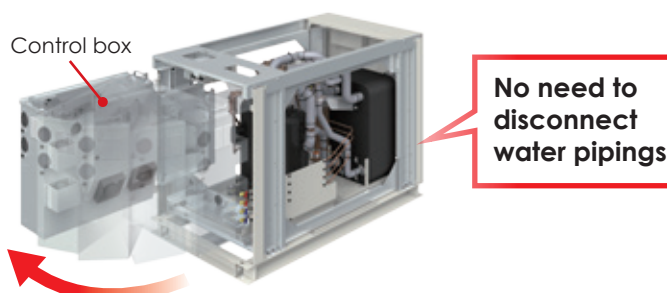


Drawable Structure

Easily approachable to each component!

* Please make sure to have enough people and use ropes to draw the internal components out.

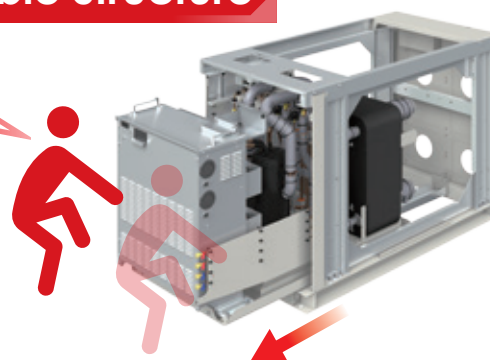

With the module chiller system, even if one unit is under maintenance, the other units can continue to operate.

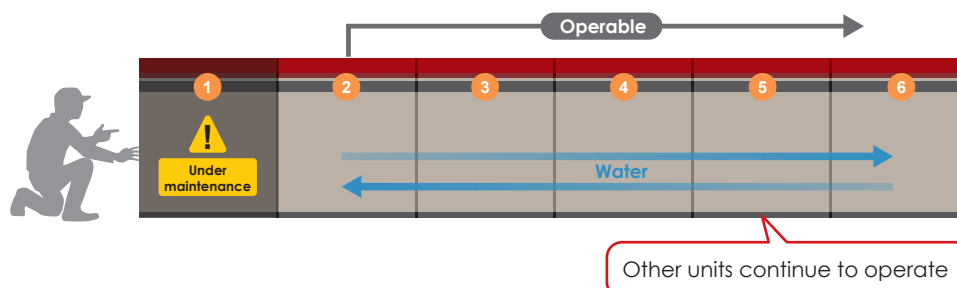

High Efficiency



Both rated and seasonal efficiency are high thanks to our original configuration. Moreover, since this inverter-driven chiller is able to operate at a partial load, higher efficiency is achievable which a fixed-speed system cannot reach.

Rated Efficiency

EER
5.05

*Under normal cooling conditions at the evaporation side water inlet temp 12°C (53.6°F) outlet temp 7°C (44.6°F) and at the condensation side water inlet temp 30°C (86°F) outlet temp 35°C (95°F). Pump input is included in cooling capacity and power input.

*Value differs when using brine

Seasonal Efficiency

SEER
7.66

*Under normal cooling conditions at the evaporation side water inlet temp 12°C (53.6°F) outlet temp 7°C (44.6°F) and at the condensation side water inlet temp 30°C (86°F) outlet temp 35°C (95°F). Pump input is included in cooling capacity and power input based on EN14511.

*Value differs when using brine

COP
4.61

*Under normal heating conditions at the condensation side water inlet temp 40°C (104°F) outlet temp 45°C (113°F) and at the evaporation side water inlet temp 10°C (50°F) outlet temp 7°C (44.6°F). Pump input is included in heating capacity and power input.

*Value differs when using brine

SCOP
(low)
7.10


*Under normal heating conditions at the condensation side water inlet temp 40°C (104°F) outlet temp 45°C (113°F) and at the evaporation side water inlet temp 10°C (50°F) outlet temp 7°C (44.6°F). Pump input is included in heating capacity and power input based on EN14511.

*Value differs when using brine


Water Temperature Range

Single unit

Cooling Operation

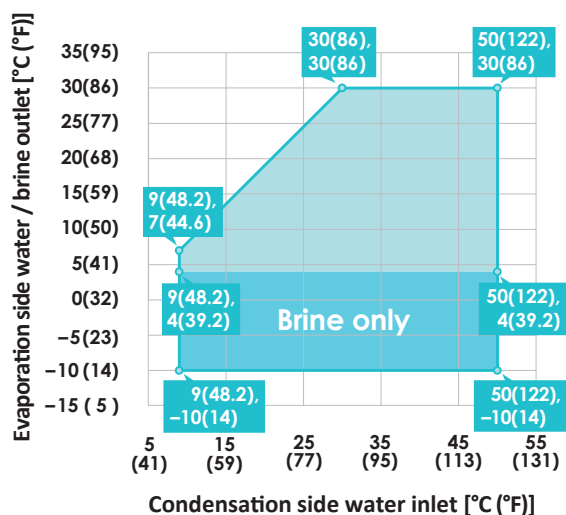

Heating Operation

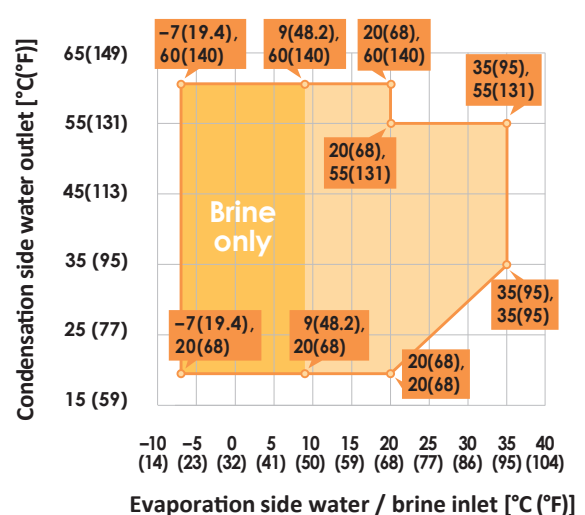

* Please set the DipSW when using brine use range.

* Please set the DipSW when switching the cooling/heating mode accordingly (the default factory setting is the cooling mode).


Optimum Frequency Control

Each group can have a maximum of 6 units to increase the capacity of the system. When multiple units are connected, the optimum frequency control function is available, achieving higher efficiency.


*Pumps are necessary to be installed on-site.

In low-load operation

Control of general fixed-speed chillers

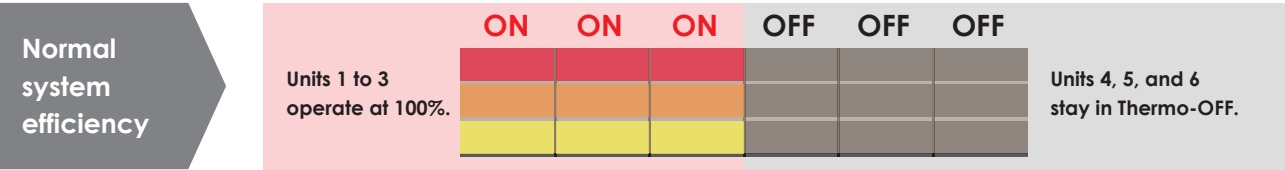


Optimum frequency control of our e-series

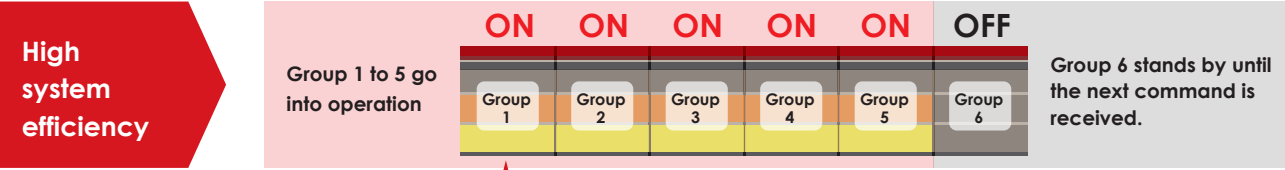

Based on the total frequency of all connected units, the system leader unit decides how many units should go into operation to achieve optimum efficiency.


Operates in accordance with the command sent from the system leader unit.

No need for metering devices to perform optimum frequency control.

- 


System leader unit
1. Based on the operating load on-site, the system leader unit calculates the number of groups need to be operated to maximize efficiency.
 2. The system leader unit sends a command to each unit to go into operation or remain stopped.
 3. Each unit controls the water temperature according to the command from the system leader unit.

Example of operation

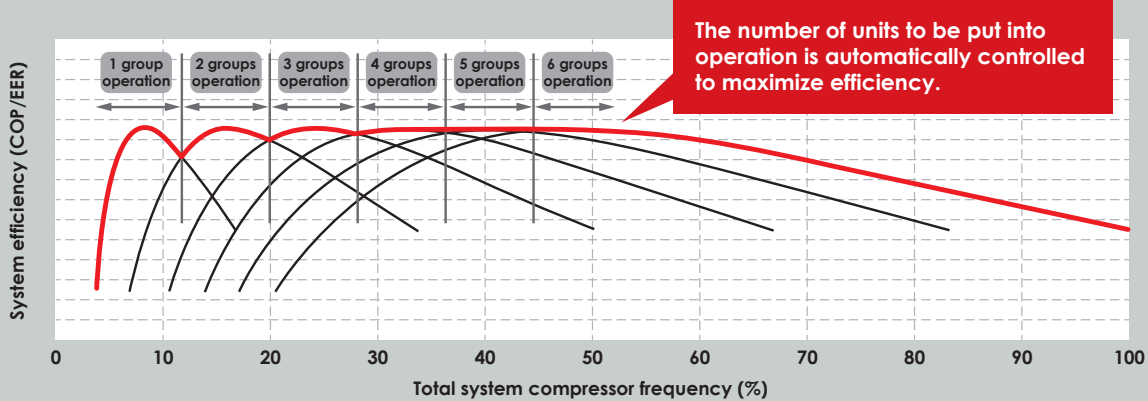


In the case of overall system load of 50%


Control of general fixed-speed chillers

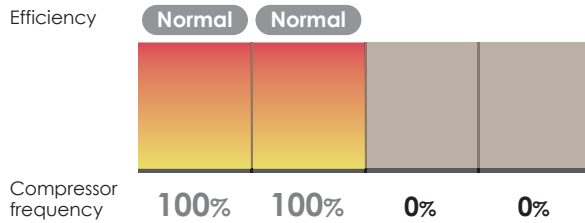


Only turning the unit on or off is possible without optimum frequency control, and compressor frequency cannot be adjusted according to the required capacity.

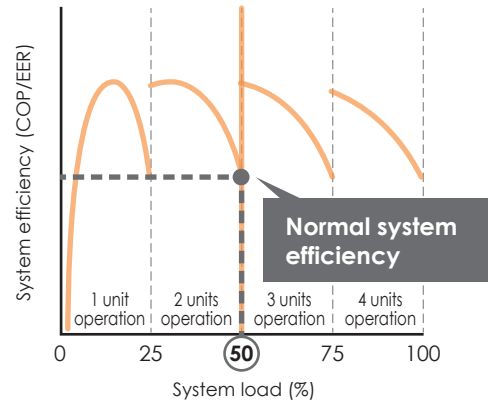

Optimum frequency control of our e-series

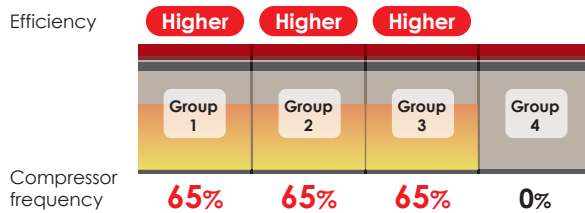


Each unit has inverter compressors, and the operating frequency and the number of units to be operated are controlled to maximize the operational efficiency of each unit based on the total system compressor frequency for the entire group.

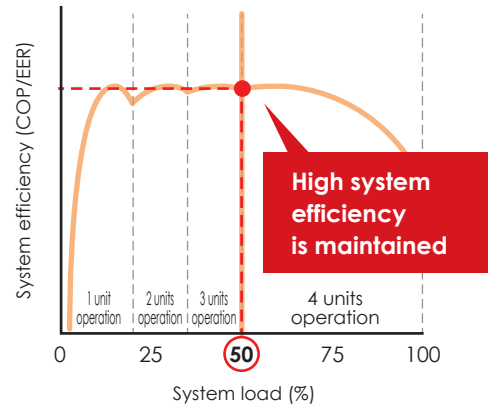

Rotation Operation

When multiple units are installed, the group of units runs alternately, ensuring an optimum product lifecycle for component units.

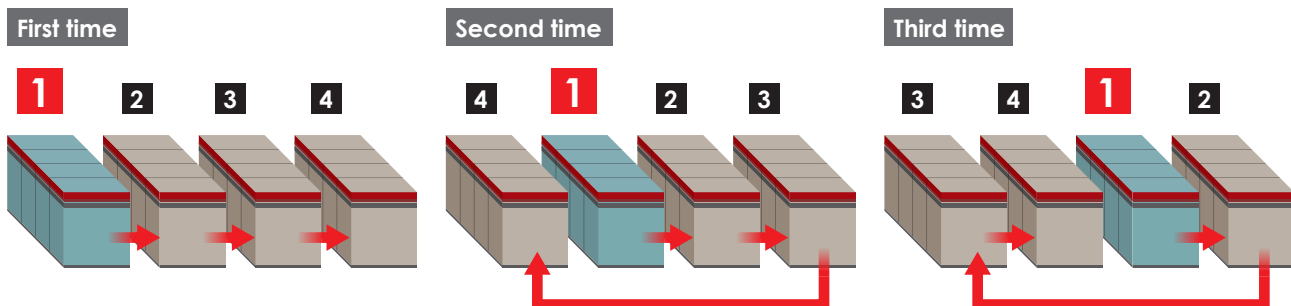

The group with shorter cumulative operation hours will go into operation first, so the operation time of the units in the same system is controlled to be equalized.


Key Technology

Compressor

Inverter-driven




Each unit has two high-efficiency R32-compatible inverter compressors developed by Mitsubishi Electric. The inverter compressor automatically controls the compressor frequency based on the fluctuating load, helping to achieve higher seasonal efficiency compared to a standard fixed-speed system.

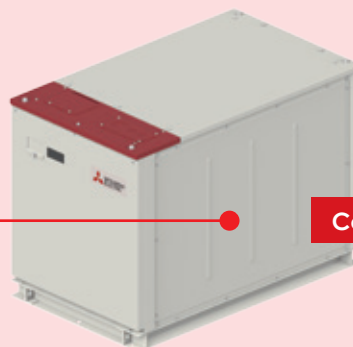

Compressor

IH (induction heating) warmer


Case heater

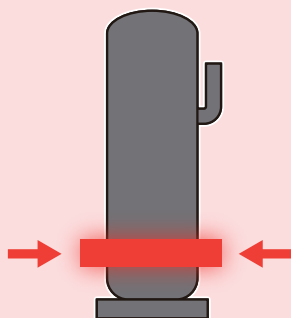


Heated from the outside with a heater

IH warmer

Heated by energizing the motor

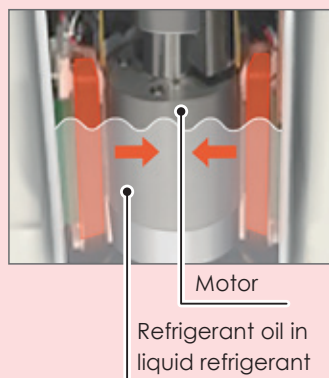

Operation while the air conditioner is stopped

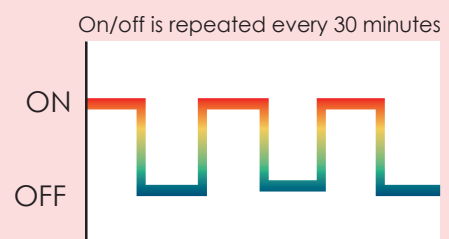


As same as the conventional air-cooled e-series, IH (induction heating) warmer is adopted to prevent refrigerant stagnation while the unit is stopped.

The IH warmer suppresses standby power more than a belt case heater, which is wrapped around the compressor shell surface to heat the compressor constantly.


Utilizing the magnetic property of the iron motor core, the motor is energized for 30 minutes after the operation is stopped at the low voltage level. Since this energization repeats every 30 minutes, standby power consumption, therefore, is lower than a belt case heater that heats the compressor constantly.

Water heat exchanger

Water heat exchanger head loss

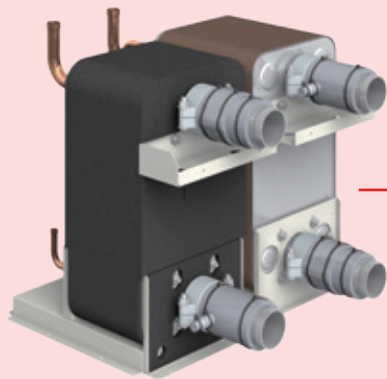


The water circuits increase the efficiency of heat exchange, which contributes to higher system efficiency.

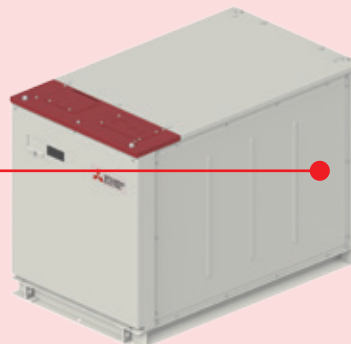

Water heat exchanger


ERCV-M900YA(Water setting)

Evaporation/Condensation heat exchanger head loss

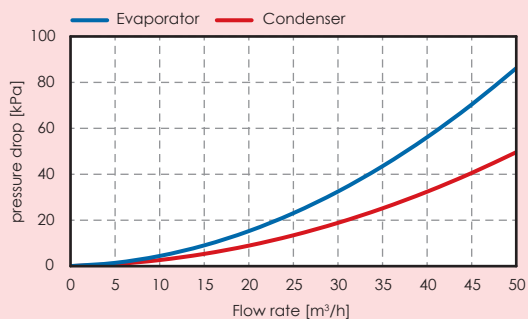


ERCV-M900YA×2(Water setting)

Evaporation/Condensation heat exchanger head loss

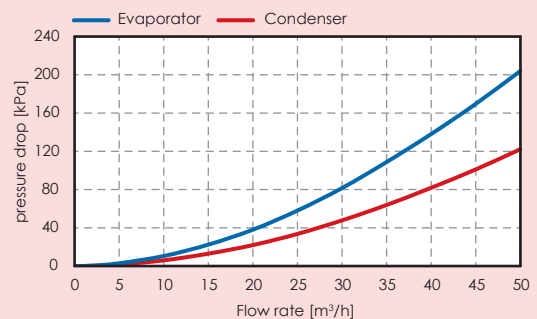

ERCV-M900YA(Brine setting)


Evaporation/Condensation heat exchanger head loss

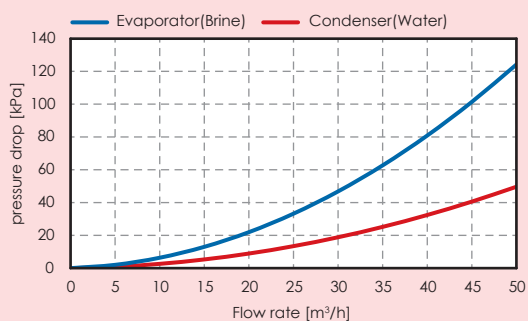

*When using brine(ethylene glycol 35wt%) as evaporation side fluid.

ERCV-M900YA×2(Brine setting)

Evaporation/Condensation heat exchanger head loss

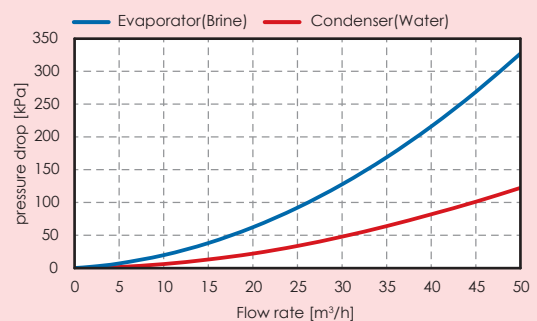

*When using brine(ethylene glycol 35wt%) as evaporation side fluid.

Easy Control



Remote controller PAR-W31MAA

The water temperature in each module is easily controllable by connecting to the local remote controller PAR-W31MAA or to the centralized controller, depending on the customers' requests.

External signal output

The external signal input from the on-site control panel can control basic operations, such as operation command and the water temperature settings.

*Optional products, such as remote controllers, are not always required.

Major functions

Input	ON/OFF Cooling/Heating/Cooling ECO/Heating ECO/ Anti-freeze Demand Target water temperature
Output	Operation command Operation mode Error
Control function	Control of the number of units

On-site control panel



Remote controller

The remote controller can control basic operations, such as ON/OFF, water temperature settings, and schedule settings.


Major functions

Input	ON/OFF Cooling/Heating/HeatingECO/Anti-freeze Demand Scheduled operation (daily/weekly) Target water temperature
Output	Operation mode Current water temperature Target temperature Error code
Control function	Control of the number of units

PAR-W31MAA



System configuration

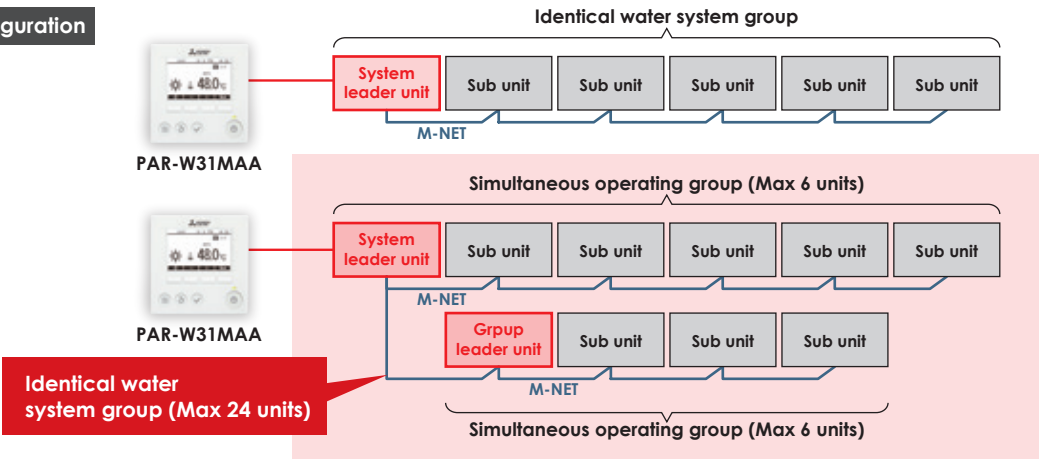


Centralized controller

The e-series units are connectable to the AE-C400 that centrally controls up to 24 units or 24 systems connected via M-NET. By using EW-C50, the maximum number of connectable units can be further increased. The use of AE-C400 enables various operation settings and integrated control of the e-series and CITY MULTI.



AE-C400

System configuration

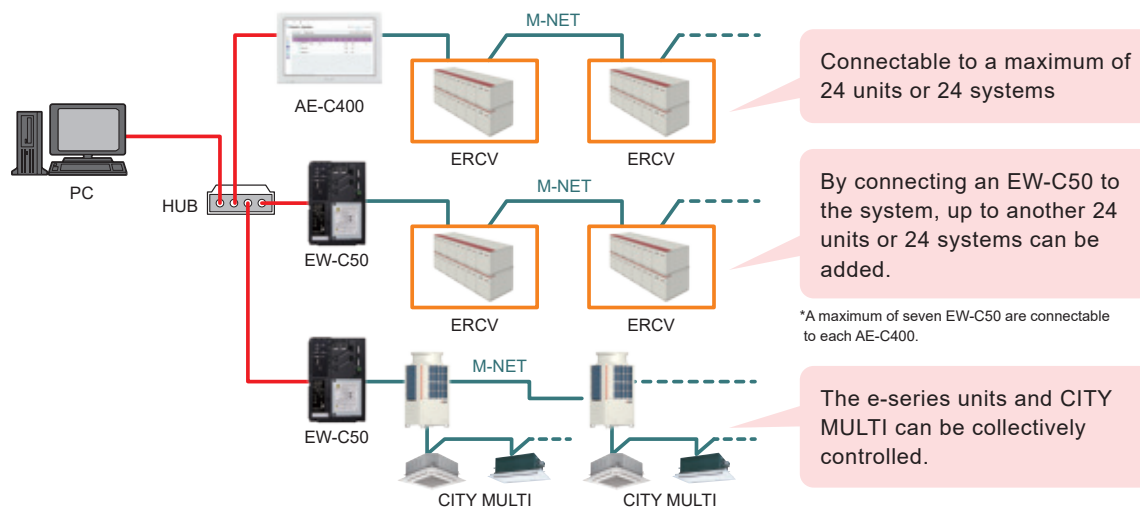

Major functions

Operation/ setting	ON/OFF
	Cooling/Heating/Heating ECO/Anti-freeze
Setting	Scheduled operation (daily/weekly/annual)
	Target temperature
	Local control disabled (ON/OFF, operation mode, target temperature)

Display	WEB browser connected
	Operation mode
Control function (function of chiller)	Current water temperature
	Error code
	Control of multiple units

BACnet® connection function

Connectable to a central monitoring device via AE-C400 using BACnet®

* BACnet® is a registered trademark of ASHRAE in the United States of America.

Setting	ON/OFF
	Target temperature
Display	Cooling/Heating/Heating ECO/Anti-freeze
	Local control disabled (ON/OFF, operation mode, target temperature)

Display	ON/OFF
	Inlet/outlet water temperature
Setting	Cooling/Heating/Heating ECO/Anti-freeze
	Local control disabled (ON/OFF, operation mode, target temperature)
Control function (function of chiller)	Collective error
	Communication error
	Individual unit error

Parts list

Optional parts

ER-01RK



A Pipe coupling×2




B Coupling water pipe×4



C Housing joint×4




D Pipe cover 1×4
(10 mm thick)



E Pipe cover 2×4
(10 mm thick)

Installing the piping kit (ER-01RK)

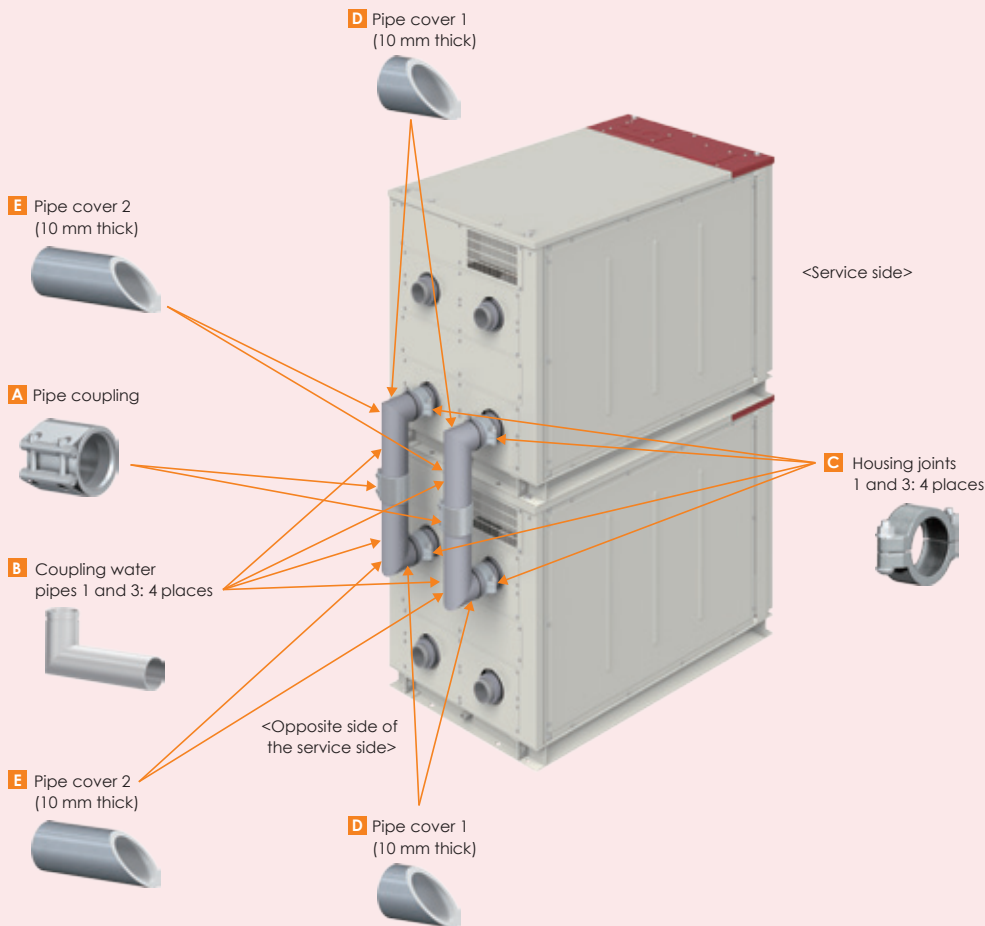


Fluorinated greenhouse gases information

Refrigerant			ERCV-M900YA	ERCV-M900YA×2
Type/GWP			R32/675	
Factory charged	Weight	kg	5.2(kg)×2	5.2(kg)×4
	CO ₂ equivalent	t	7.0	14.0

R32 refrigerant properties

Under the conditions shown below, there is a possibility that R32 could burn.

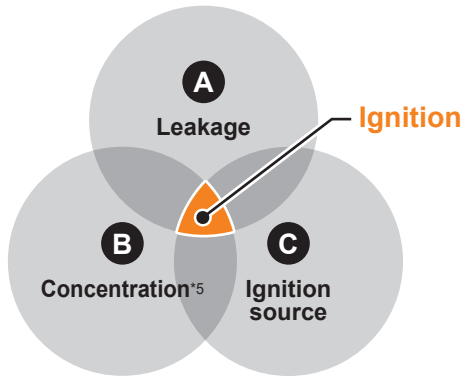

	R32	R410A
Chemical formula	CH ₂ F ₂	CH ₂ F ₂ /CHF ₂ CF ₃
Composition (blend ratio wt. %)	Single composition	R32/R125 (50/50 wt %)
Ozone depletion potential (ODP)	0	0
Global warming potential (GWP) *1	675	2088
LFL(vol.%) *2	13.3	—
UFL(vol.%) *3	29.3	—
Flammability *4	Lower flammability (2L)	No flame propagation (1)

*1 IPCC 4th assessment report

*2 LFL: Lower flammable limit

*3 UFL: Upper flammable limit

*4 ISO 817:2014

*5 R32 consistency is higher than LFL^{*2} and lower than UFL^{*3}.

Be sure to observe the following three points to use R32 safely.

⚠ WARNING

A Do not leak refrigerant.

- <Installation> • Vacuum drying should be done. Do not release refrigerant into the atmosphere unnecessarily.
• Follow "Installation points of charging refrigerant."
<Repair/Removal> • Refrigerant should be recovered.

B Prevent concentration.

- Follow "Installation restrictions".

C Keep ignition sources away from the unit.

- Do not braze pipes that contain refrigerant. Before brazing, refrigerant should be recovered.
• Do not install the unit while electricity is on. Turn off electricity and check using a tester.
• Do not smoke during work and transportation.

Note: Both R32 / R410A emit toxic gas when exposed to naked flame.

Tools

Tools	Gauge manifold	Charge hose	Electronic weight scales	Charge valve	Electric leak tester (Gas leak detector)	Vacuum pump	Vacuum pump adapter	Refrigerant recovery equipment	Refrigerant recovery cylinder
								*1	*2

Note: Be sure to confirm with the manufacturers that the electric leak tester, vacuum pump and refrigerant recovery equipment are compliant with R32.

*1 Refer to catalogs provided by the manufacturers of the tools above to ensure that the tools are usable with R32.

*2 Do not use R32 and R410A in combination in the same refrigerant recovery cylinder.

Installation restrictions

General restrictions

! WARNING

Do not install the unit where combustible gas may leak.

- If combustible gas accumulates around the unit, fire or explosion may result.


- Provide sufficient space around the unit for effective operation, efficient air movement, and ease of access for maintenance.
- All restrictions mentioned in this manual apply not only to new installations but also to relocations and layout changes.
- Refer to the Installation Manual for other precautions on installation.

Installation space requirement

This unit is for exclusive use in a machine room with ventilation equipment.

As shown in the figure below, install the unit in a machine room with ventilation equipment.


*The requirements described below were established based on IEC60335-2-40 (ver.6) and ISO5149 (2014).

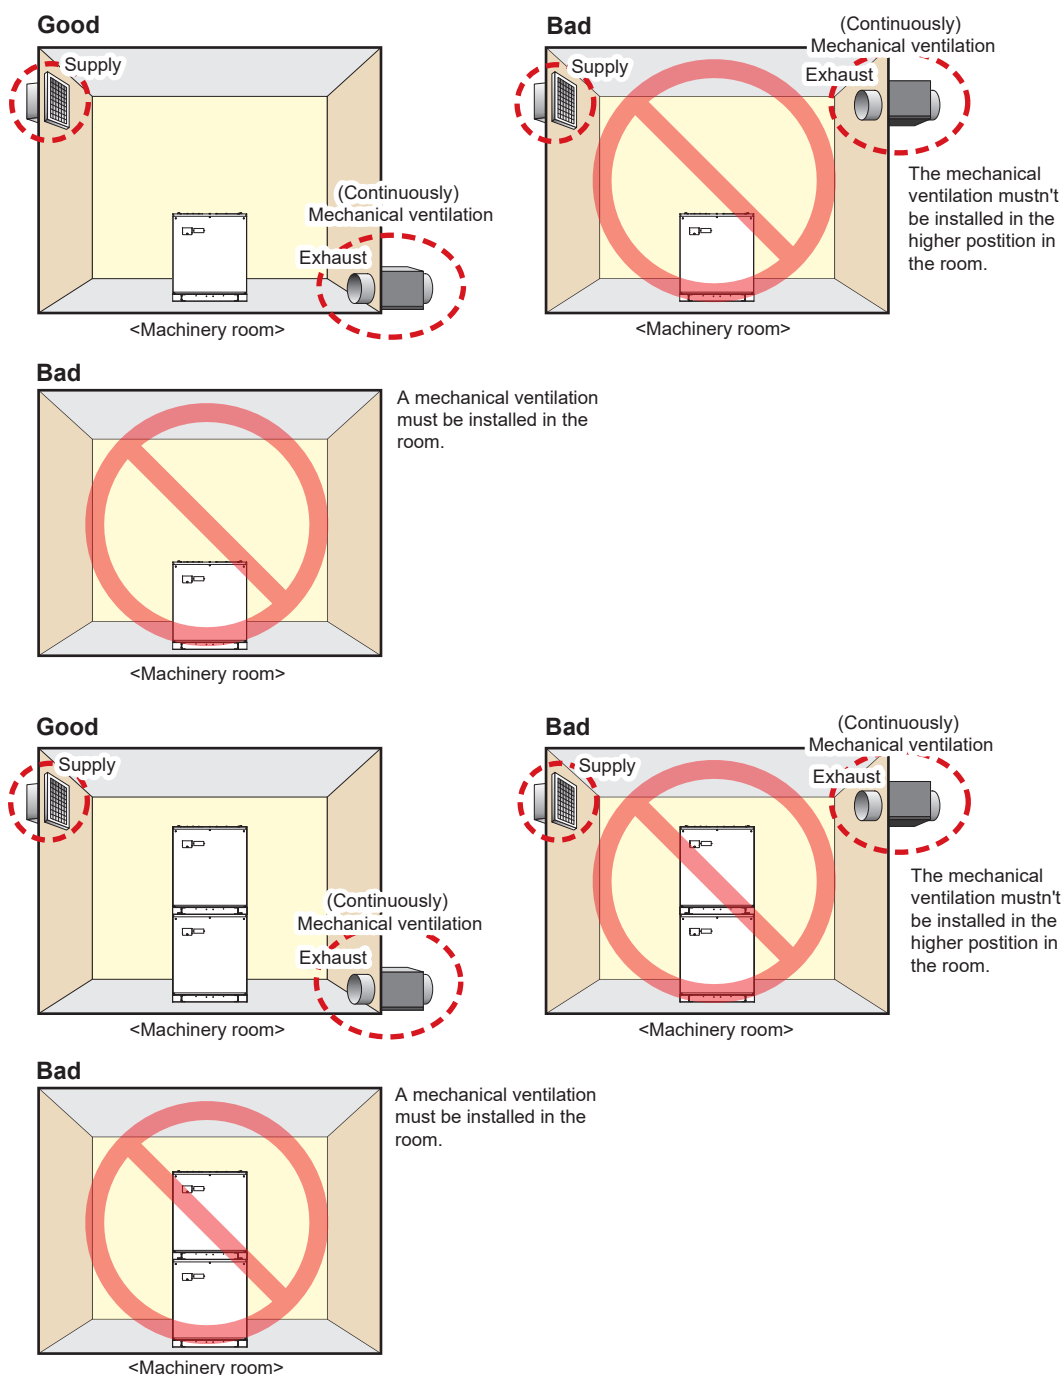

Regulatory requirements for safety


See below for information on installing a safety device on the water-cooled chilling unit system.

- * Safety devices shall be regularly inspected, maintained, and replaced in accordance with relevant laws, regulations, and the instructions of the manufacturers.
- * The requirements listed below were established based on IEC60335-2-40 (ver.6). See the original standards for further information on selecting a safety device.

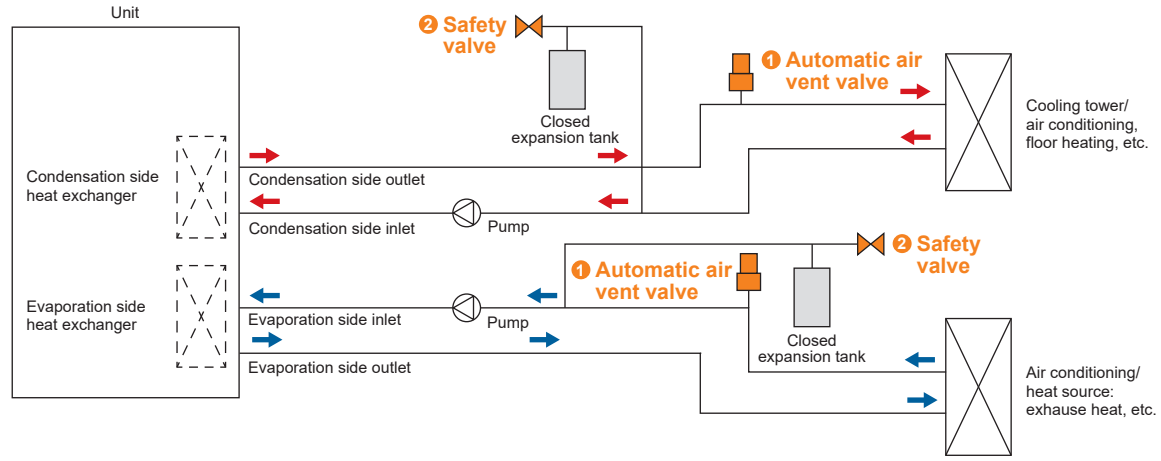

Required items	Note
① Automatic air vent valve	* In the event of a failure of the waterside heat exchanger in the unit, the refrigerant may leak from the automatic air vent valve, so install it in a place where the refrigerant will not accumulate, such as outdoors.
② Safety valve	* In the event of a failure of the waterside heat exchanger in the unit, the refrigerant may leak from the safety valve, so install it in a place where the refrigerant will not accumulate, such as outdoors.

On-site water piping connection example

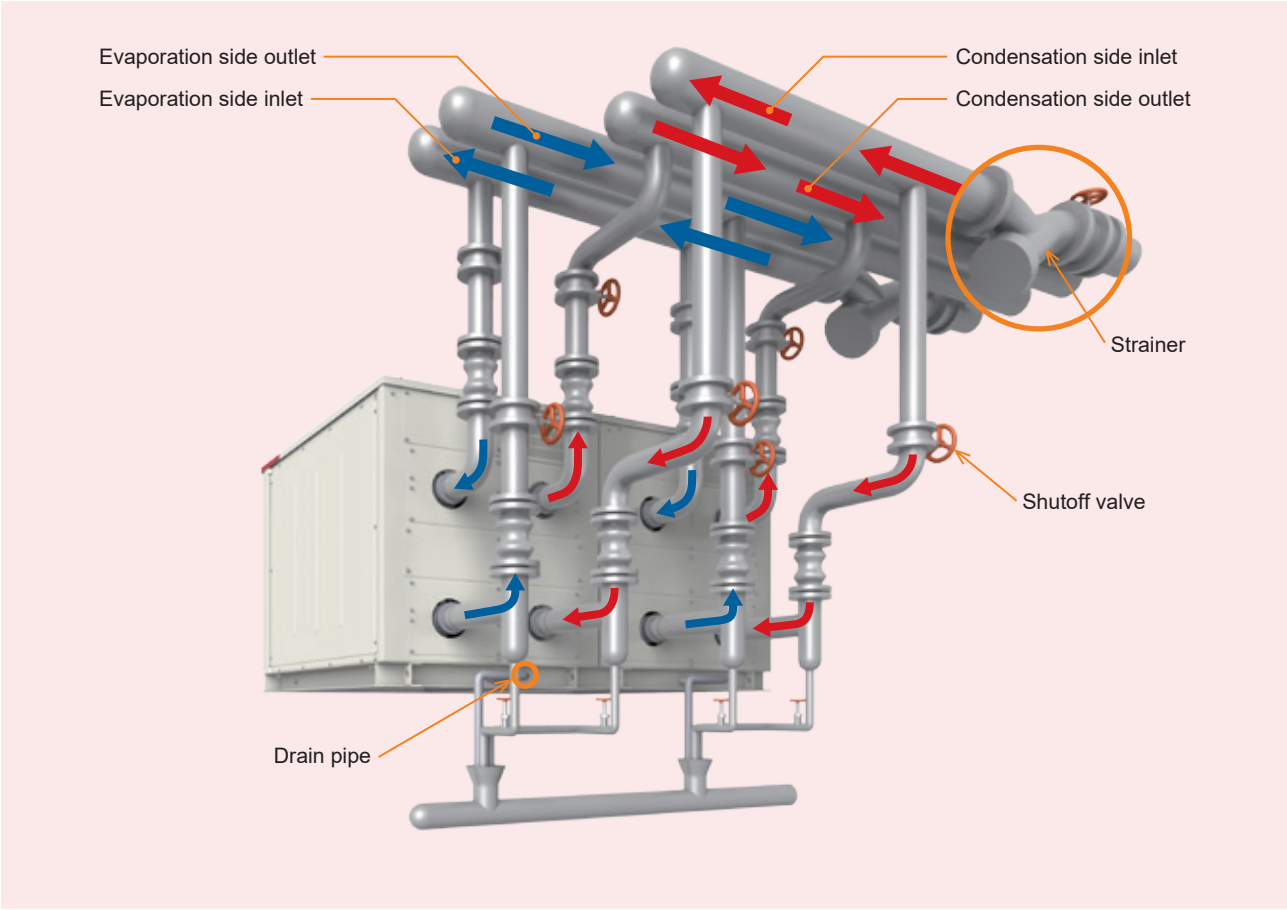

Specifications

Single(Water setting)

*When using water as evaporation side fluid (SW6-10:OFF Water setting)

Model			ERCV-M900YA	
Capacity change mode			Capacity priority	Efficiency priority
Power source			3-phase 4-wire 380-400-415V 50/60Hz	
Cooling capacity *1		kW	90.00	45.00
		kcal/h	77,400	38,700
		BTU/h	307,080	153,540
	Power input	kW	17.47	8.22
	EER		5.15	5.47
	IPLV *5		8.18	—
	Evaporation side water flow rate	m ³ /h	15.5	7.7
	Condensation side water flow rate	m ³ /h	17.9	8.9
		kW	89.83	44.95
		kcal/h	77,254	38,657
		BTU/h	306,500	153,369
Cooling capacity (EN14511) *2	Power input	kW	17.80	8.31
	EER		5.05	5.41
	SEER		7.66	—
	ηsc	%	303.4	—
	Evaporation side water flow rate	m ³ /h	15.5	7.7
	Condensation side water flow rate	m ³ /h	17.9	8.9
		kW	90.00	45.00
		kcal/h	77,400	38,700
		BTU/h	307,080	153,540
	Power input	kW	19.07	9.40
Heating capacity *3	COP		4.72	4.79
	Condensation side water flow rate	m ³ /h	15.5	7.7
	Evaporation side water flow rate	m ³ /h	21.5	10.7
		kW	90.12	45.03
		kcal/h	77,503	38,726
		BTU/h	307,489	153,642
	Power input	kW	19.53	9.52
	COP		4.61	4.73
	SCOP Low/Medium		7.10/4.86	—
	ηsh Low/Medium	%	281.0/191.0	—
Heating capacity (EN14511) *4	Condensation side water flow rate	m ³ /h	15.5	7.7
	Evaporation side water flow rate	m ³ /h	21.5	10.7
	Cooling current 380-400-415V *1	A	29 - 27 - 26	13 - 13 - 12
	Heating current 380-400-415V *3	A	31 - 30 - 29	15 - 15 - 14
	Maximum current	A	60	
	Evaporation side	kPa	10	3
	Condensation side	kPa	7	2
	Evaporation side water outlet	°C	4~30	
		°F	39~86	
	Condensation side water inlet	°C	9~50	
		°F	48~122	
Temperature range (Cooling) *7	Condensation side water outlet	°C	20~60 *6	
		°F	68~140	
	Evaporation side water inlet	°C	9~35	
		°F	48~95	
	Evaporation side	m ³ /h	7.7~25.8	
		m ³ /h	4.5~30.0 *10	
Sound pressure level (measured in anechoic room) at 1m *1		dB (A)	53	48
		dB (A)	72	66
Sound power level (measured in anechoic room) *11	Inlet	mm (in)	65A (2 1/2B) housing type joint	
	Outlet	mm (in)	65A (2 1/2B) housing type joint	
Diameter of water pipe (Evaporation side)	Inlet	mm (in)	65A (2 1/2B) housing type joint	
	Outlet	mm (in)	65A (2 1/2B) housing type joint	
Diameter of water pipe (Condensation side)	Inlet	mm (in)	65A (2 1/2B) housing type joint	
	Outlet	mm (in)	65A (2 1/2B) housing type joint	
External finish			Polyester powder coating steel plate	
External dimension HxWxD			918 x 780 x 1350	
Net weight			430 (948)	
Design pressure	R32	MPa	4.15	
	Water	MPa	1.0	
Heat exchanger	Evaporation side		Stainless steel plate and copper brazing	
	Condensation side		Stainless steel plate and copper brazing	
Compressor	Type		Inverter scroll hermetic compressor	
	Maker		MITSUBISHI ELECTRIC CORPORATION	
	Starting method		Inverter	
	Quantity		2	
	Motor output	kW	8.3 x 2	
	Lubricant		MEL46EH	
Protection	High pressure protection		High pressure Switch at 4.15MPa (601psi)	
	Inverter circuit		Over-heat protection, Over current protection	
	Compressor		Over-heat protection	
Refrigerant	Type x charge		R32 x 5.2 (kg) x 2	
	Control		LEV	

*1 Under normal cooling conditions at evaporation side water inlet temp 12°C(53.6°F) outlet temp 7°C(44.6°F)

condensation side water inlet temp 30°C(86°F) outlet temp 35°C(95°F). Pump input is not included in cooling capacity and power input.

*2 Under normal cooling conditions at evaporation side water inlet temp 12°C(53.6°F) outlet temp 7°C(44.6°F)

condensation side water inlet temp 30°C(86°F) outlet temp 35°C(95°F). Pump input is included in cooling capacity and power input based on EN14511.

*3 Under normal heating conditions at condensation side water inlet temp 40°C(104°F) outlet temp 45°C(113°F)

evaporation side water inlet temp 10°C(50°F) outlet temp 7°C(44.6°F). Pump input is not included in cooling capacity and power input.

*4 Under normal heating conditions at condensation side water inlet temp 40°C(104°F) outlet temp 45°C(113°F)

evaporation side water inlet temp 10°C(50°F) outlet temp 7°C(44.6°F). Pump input is included in cooling capacity and power input based on EN14511.

*5 IPLV is calculated in accordance with AHRI 551-591.

*6 When using in condensation side water outlet is more than 55°C(131°F), please adjust the condensation side inlet water temperature to 50°C(122°F) or less.

• Please don't use the steel material for the water piping.

• Please always make water circulate, or pull the circulation water out completely when not in use.


• Please do not use groundwater or well water in direct.

• The water circuit must be closed circuit.


• Due to continuous improvement, the above specifications may be subject to change without notice.

• This model doesn't equip with a pump.


*7 Capacity priority/Efficiency priority

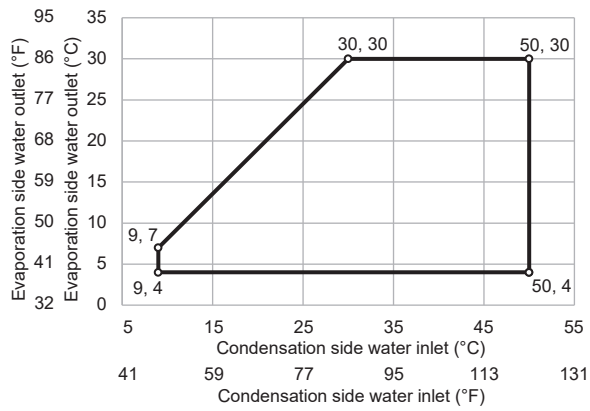

*8 Capacity priority

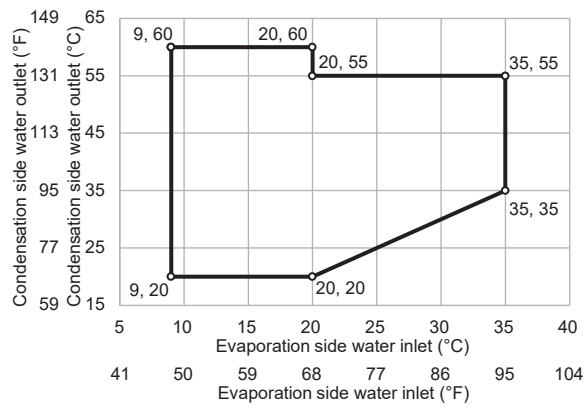

*9 Efficiency priority

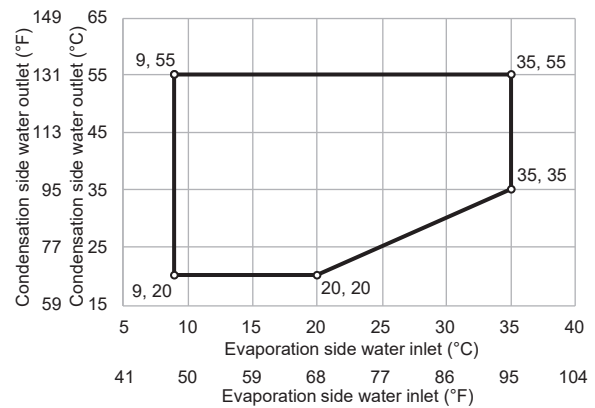

*10 Set the minimum water flow rate on the condensation side water to 8.0m³/h when the evaporation side water inlet temperature during operation is 15°C(59°F) or higher.

Single(Brine setting)

*When using brine as evaporation side fluid (SW6-10:ON Brine setting)

Model			ERCV-M900YA
Power source			3-phase 4-wire 380-400-415V 50/60Hz
Cooling capacity *1*5		kW	90.00
		kcal/h	77,400
		BTU/h	307,080
	Power input	kW	17.47
	EER		5.15
	Evaporation side brine flow rate	m ³ /h	17.2
Cooling capacity (EN14511) *2*5		kW	89.73
		kcal/h	77,168
		BTU/h	306,159
	Power input	kW	17.91
	EER		5.01
	SEER		7.65
Heating capacity *3*5		kW	80.00
		kcal/h	68,800
		BTU/h	272,960
	Power input	kW	22.13
	COP		3.62
	Condensation side water flow rate	m ³ /h	13.8
Heating capacity (EN14511) *4*5		kW	80.10
		kcal/h	68,886
		BTU/h	273,301
	Power input	kW	22.59
	COP		3.55
	SCOP Low/Medium		4.87/3.52
Current input *5		kW	19.1
		kcal/h	13.8
		BTU/h	19.1
	Condensation side water flow rate	m ³ /h	13.8
	Evaporation side brine flow rate	m ³ /h	19.1
	Evaporation side brine flow rate	m ³ /h	19.1
Maximum current		kW	19.1
		kcal/h	13.8
		BTU/h	19.1
	Condensation side water flow rate	m ³ /h	13.8
	Evaporation side brine flow rate	m ³ /h	19.1
	Evaporation side brine flow rate	m ³ /h	19.1
Brine/Water pressure drop *1*5		kPa	17
		kPa	7
		kPa	7
	Evaporation side brine	kPa	17
	Condensation side water	kPa	7
	Condensation side water	kPa	7
Temperature range (Cooling) *5*7		°C	-10 ~ 30
		°F	14 ~ 86
		°C	9 ~ 50
		°F	48 ~ 122
		°C	20 ~ 60*6
		°F	68 ~ 140
Temperature range (Heating) *5*8		°C	-7 ~ 35
		°F	19 ~ 95
		°C	7.7 ~ 28.7
		°F	45 ~ 83
		°C	4.5 ~ 30.0 *9
		°F	40 ~ 86
Circulating brine / water volume range		m ³ /h	7.7 ~ 28.7
		m ³ /h	4.5 ~ 30.0 *9
		m ³ /h	4.5 ~ 30.0 *9
	Evaporation side brine	m ³ /h	7.7 ~ 28.7
	Condensation side water	m ³ /h	4.5 ~ 30.0 *9
	Condensation side water	m ³ /h	4.5 ~ 30.0 *9
Sound pressure level (measured in anechoic room) at 1m *1		dB (A)	53
		dB (A)	72
		dB (A)	72
	Evaporation side	dB (A)	65A (2 1/2B) housing type joint
	Condensation side	dB (A)	65A (2 1/2B) housing type joint
	Condensation side	dB (A)	65A (2 1/2B) housing type joint
Diameter of water pipe (Evaporation side)		mm (in)	65A (2 1/2B) housing type joint
		mm (in)	65A (2 1/2B) housing type joint
		mm (in)	65A (2 1/2B) housing type joint
	Evaporation side	mm (in)	65A (2 1/2B) housing type joint
	Condensation side	mm (in)	65A (2 1/2B) housing type joint
	Condensation side	mm (in)	65A (2 1/2B) housing type joint
External finish		mm	918 x 780 x 1350
		kg (lbs)	430 (948)
		MPa	4.15
	Water	MPa	1.0
	Evaporation side		Stainless steel plate and copper brazing
	Condensation side		Stainless steel plate and copper brazing
Compressor			Inverter scroll hermetic compressor
			MITSUBISHI ELECTRIC CORPORATION
			Inverter
	Starting method		Inverter
	Quantity		2
	Motor output	kW	8.3 x 2
Protection			MEL46EH
			MEL46EH
			MEL46EH
	High pressure protection		High pressure Switch at 4.15MPa (601psi)
	Inverter circuit		Over-heat protection, Over current protection
	Compressor		Over-heat protection
Refrigerant			R32 x 5.2(kg) x 2
			R32 x 5.2(kg) x 2
			LEV
	Type x charge		R32 x 5.2(kg) x 2
	Control		LEV
	Control		LEV

*1 Under normal cooling conditions at evaporation side brine inlet temp 12°C(53.6°F) outlet temp 7°C(44.6°F)

condensation side water inlet temp 30°C(86°F) outlet temp 35°C(95°F). Pump input is not included in cooling capacity and power input.

*2 Under normal cooling conditions at evaporation side brine inlet temp 12°C(53.6°F) outlet temp 7°C(44.6°F)

condensation side water inlet temp 30°C(86°F) outlet temp 35°C(95°F). Pump input is included in cooling capacity and power input based on EN14511.

*3 Under normal heating conditions at condensation side water inlet temp 40°C(104°F) outlet temp 45°C(113°F)

evaporation side brine inlet temp 0°C(32°F) outlet temp -3°C(26.6°F). Pump input is not included in cooling capacity and power input.

*4 Under normal heating conditions at condensation side water inlet temp 40°C(104°F) outlet temp 45°C(113°F)


evaporation side brine inlet temp 0°C(32°F) outlet temp -3°C(26.6°F). Pump input is included in cooling capacity and power input based on EN14511.

*5 When using brine(ethylene glycol 35wt%) as evaporation side fluid.


*6 When using in condensation side water outlet is more than 55°C(131°F), please adjust the condensation side inlet water temperature to 50°C(122°F) or less.

- Please don't use the steel material for the water piping.
- Please always make water circulate, or pull the circulation water out completely when not in use.
- Please do not use groundwater or well water in direct.
- The water circuit must be closed circuit.
- Due to continuous improvement, the above specifications may be subject to change without notice.
- This model doesn't equip with a pump.

*7

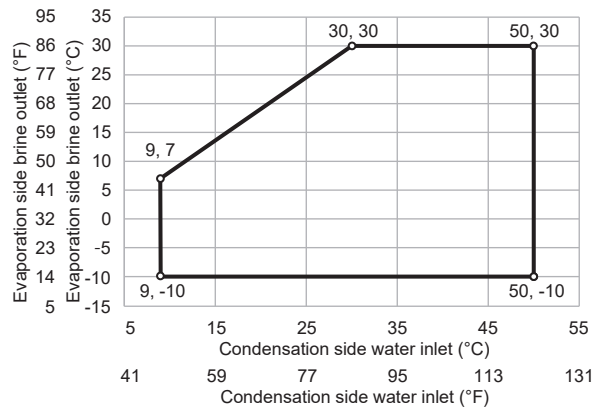

*8

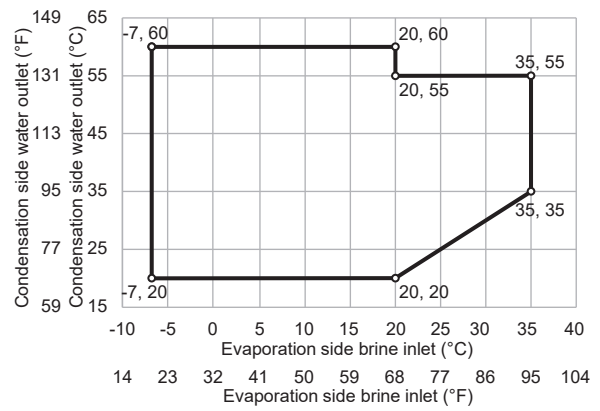

*9 Set the minimum water flow rate on the condensation side water to 8.0m³/h when the evaporation side brine inlet temperature during operation is 15°C(59°F) or higher.

Double Stack(Water setting)

*When using water as evaporation side fluid (SW6-10:OFF Water setting)

Model			ERCV-M900YA×2			
Capacity change mode			Capacity priority	Efficiency priority		
Power source			3-phase 4-wire 380-400-415V 50/60Hz			
Cooling capacity *1			kW	180.00	90.00	
			kcal/h	154,800	77,400	
			BTU/h	614,160	307,080	
			Power input	kW	33.07	15.24
			EER		5.44	5.91
			IPLV *5		8.61	-
			Evaporation side water flow rate	m³/h	31.0	15.5
			Condensation side water flow rate	m³/h	35.9	17.5
Cooling capacity (EN14511) *2			kW	178.71	89.66	
			kcal/h	153,691	77,108	
			BTU/h	609,759	305,920	
			Power input	kW	35.54	15.87
			EER		5.03	5.65
			Evaporation side water flow rate	m³/h	31.0	15.5
			Condensation side water flow rate	m³/h	35.9	17.5
			Heating capacity *3			kW
kcal/h	154,800	77,400				
BTU/h	614,160	307,080				
Power input	kW	37.22				18.39
COP		4.84				4.89
Condensation side water flow rate	m³/h	31.0				15.5
Evaporation side water flow rate	m³/h	42.7				21.7
Heating capacity (EN14511) *4						kW
			kcal/h	155,548	77,598	
			BTU/h	617,128	307,865	
			Power input	kW	40.90	19.26
			COP		4.42	4.68
			Condensation side water flow rate	m³/h	31.0	15.5
			Evaporation side water flow rate	m³/h	42.7	21.7
			Current input			Cooling current 380-400-415V *1
Heating current 380-400-415V *3	A	61 - 58 - 56				30 - 29 - 28
Maximum current	A					120
Water pressure drop *1			Evaporation side	kPa	85	25
			Condensation side	kPa	66	18
Temperature range (Cooling) *6			Evaporation side water outlet	°C	4~30	
				°F	39~86	
			Condensation side water inlet	°C	9~50	
				°F	48~122	
Temperature range (Heating) *7			Condensation side water outlet	°C	20~55	
				°F	68~131	
			Evaporation side water inlet	°C	9~35	
				°F	48~95	
Circulating water volume range			Evaporation side	m³/h	15.4~50.0	
			Condensation side	m³/h	9.0~50.0 *8	
Sound pressure level (measured in anechoic room) at 1m *1			dB (A)	56	51	
Sound power level (measured in anechoic room) *1			dB (A)	75	69	
Diameter of water pipe (Evaporation side)	Inlet	mm (in)	65A (2 1/2B) housing type joint			
	Outlet	mm (in)	65A (2 1/2B) housing type joint			
Diameter of water pipe (Condensation side)	Inlet	mm (in)	65A (2 1/2B) housing type joint			
	Outlet	mm (in)	65A (2 1/2B) housing type joint			
External finish			Polyester powder coating steel plate			
External dimension HxWxD		mm	1836 x 780 x 1350			
Net weight		kg (lbs)	863 (1903)			
Design pressure	R32	MPa	4.15			
	Water	MPa	1.0			
Heat exchanger	Evaporation side		Stainless steel plate and copper brazing			
	Condensation side		Stainless steel plate and copper brazing			
Compressor	Type		Inverter scroll hermetic compressor			
	Maker		MITSUBISHI ELECTRIC CORPORATION			
	Starting method		Inverter			
	Quantity		4			
	Motor output	kW	8.3 x 4			
	Lubricant		MEL46EH			
	Protection	High pressure protection	High pressure Switch at 4.15MPa (601psi)			
Refrigerant	Inverter circuit		Over-heat protection, Over current protection			
	Compressor		Over-heat protection			
	Type x charge		R32 x 5.2 (kg) x 4			
	Control		LEV			

*1 Under normal cooling conditions at evaporation side water inlet temp 12°C(53.6°F) outlet temp 7°C(44.6°F)
condensation side water inlet temp 30°C(86°F) outlet temp 35°C(95°F). Pump input is not included in cooling capacity and power input.

*2 Under normal cooling conditions at evaporation side water inlet temp 12°C(53.6°F) outlet temp 7°C(44.6°F)
condensation side water inlet temp 30°C(86°F) outlet temp 35°C(95°F). Pump input is included in cooling capacity and power input based on EN14511.


*3 Under normal heating conditions at condensation side water inlet temp 40°C(104°F) outlet temp 45°C(113°F)
evaporation side water inlet temp 10°C(50°F) outlet temp 7°C(44.6°F). Pump input is not included in cooling capacity and power input.

*4 Under normal heating conditions at condensation side water inlet temp 40°C(104°F) outlet temp 45°C(113°F)
evaporation side water inlet temp 10°C(50°F) outlet temp 7°C(44.6°F). Pump input is included in cooling capacity and power input based on EN14511.


*5 IPLV is calculated in accordance with AHRI 551-591.

- Please don't use the steel material for the water piping.
- Please always make water circulate, or pull the circulation water out completely when not in use.
- Please do not use groundwater or well water in direct.
- The water circuit must be closed circuit.
- Due to continuous improvement, the above specifications may be subject to change without notice.
- This model doesn't equip with a pump.

*6

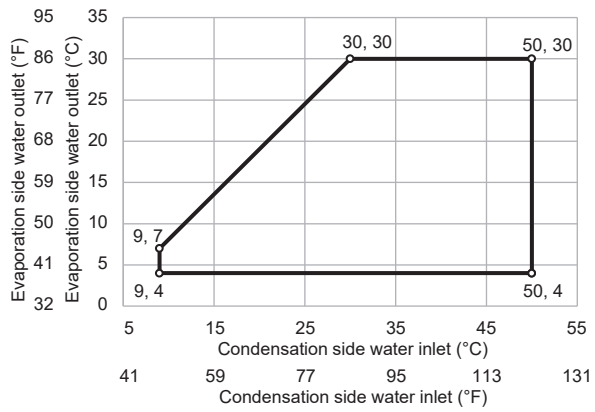

*7

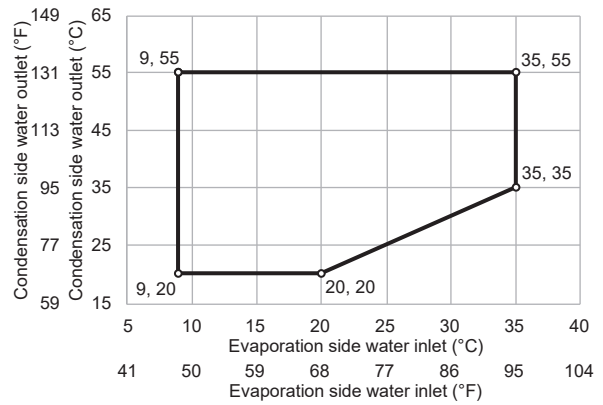

*8 Set the minimum water flow rate on the condensation side water to 16.0m³/h when the evaporation side water inlet temperature during operation is 15°C(59°F) or higher.

Double Stack(Brine setting)

*When using brine as evaporation side fluid (SW6-10:ON Brine setting)

Model			ERCV-M900YA×2
Power source			3-phase 4-wire 380-400-415V 50/60Hz
Cooling capacity *1*5		kW	180.00
		kcal/h	154,800
		BTU/h	614,160
	Power input	kW	33.07
	EER		5.44
	Evaporation side brine flow rate	m³/h	34.5
	Condensation side water flow rate	m³/h	35.9
Cooling capacity (EN14511) *2*5		kW	177.72
		kcal/h	152,839
		BTU/h	606,381
	Power input	kW	36.53
	EER		4.87
	Evaporation side brine flow rate	m³/h	34.5
	Condensation side water flow rate	m³/h	35.9
Heating capacity *3*5		kW	160.00
		kcal/h	137,600
		BTU/h	545,920
	Power input	kW	43.39
	COP		3.69
	Condensation side water flow rate	m³/h	27.5
	Evaporation side brine flow rate	m³/h	38.4
Heating capacity (EN14511) *4*5		kW	160.69
		kcal/h	138,193
		BTU/h	548,274
	Power input	kW	47.29
	COP		3.40
	Condensation side water flow rate	m³/h	27.5
	Evaporation side brine flow rate	m³/h	38.4
Current input *5	Cooling current 380-400-415V *1	A	54-51-49
	Heating current 380-400-415V *3	A	71-67-65
	Maximum current	A	120
Brine/Water pressure drop *1*5	Evaporation side brine	kPa	149
	Condensation side water	kPa	66
Temperarure range (Cooling) *5*6	Evaporation side brine outlet	°C	-10 ~ 30
		°F	14 ~ 86
	Condensation side water inlet	°C	9 ~ 50
		°F	48 ~ 122
Temperature range (Heating) *5*7	Condensation side water outlet	°C	20 ~ 55
		°F	68 ~ 131
	Evaporation side brine inlet	°C	-7 ~ 35
		°F	19 ~ 95
Circulating brine / water volume range	Evaporation side brine	m³/h	15.4 ~ 50.0
	Condensation side water	m³/h	9.0 ~ 50.0 *8
Sound pressure level (measured in anechoic room) at 1m *1			dB (A)
Sound power level (measured in anechoic room) *1			dB (A)
Diameter of water pipe (Evaporation side)	Inlet	mm (in)	65A (2 1/2B) housing type joint
	Outlet	mm (in)	65A (2 1/2B) housing type joint
Diameter of water pipe (Condensation side)	Inlet	mm (in)	65A (2 1/2B) housing type joint
	Outlet	mm (in)	65A (2 1/2B) housing type joint
External finish			Polyester powder coating steel plate
External dimension HxWxD			mm
Net weight			kg (lbs)
Design pressure	R32	MPa	4.15
	Water	MPa	1.0
Heat exchanger	Evaporation side		Stainless steel plate and copper brazing
	Condensation side		Stainless steel plate and copper brazing
Compressor	Type		Inverter scroll hermetic compressor
	Maker		MITSUBISHI ELECTRIC CORPORATION
	Starting method		Inverter
	Quantity		4
	Motor output	kW	8.3×4
	Lubricant		MEL46EH
Protection	High pressure protection		High pressure Switch at 4.15MPa (601psi)
	Inverter circuit		Over-heat protection, Over current protection
	Compressor		Over-heat protection
Refrigerant	Type x charge		R32 x 5.2(kg) x 4
	Control		LEV

*1 Under normal cooling conditions at evaporation side brine inlet temp 12°C(53.6°F) outlet temp 7°C(44.6°F)

condensation side water inlet temp 30°C(86°F) outlet temp 35°C(95°F). Pump input is not included in cooling capacity and power input.

*2 Under normal cooling conditions at evaporation side brine inlet temp 12°C(53.6°F) outlet temp 7°C(44.6°F)

condensation side water inlet temp 30°C(86°F) outlet temp 35°C(95°F). Pump input is included in cooling capacity and power input based on EN14511.

*3 Under normal heating conditions at condensation side water inlet temp 40°C(104°F) outlet temp 45°C(113°F)

evaporation side brine inlet temp 0°C(32°F) outlet temp -3°C(26.6°F). Pump input is not included in cooling capacity and power input.


*4 Under normal heating conditions at condensation side water inlet temp 40°C(104°F) outlet temp 45°C(113°F)

evaporation side brine inlet temp 0°C(32°F) outlet temp -3°C(26.6°F). Pump input is included in cooling capacity and power input based on EN14511.


*5 When using brine(ethylene glycol 35wt%) as evaporation side fluid.

- Please don't use the steel material for the water piping.
- Please always make water circulate, or pull the circulation water out completely when not in use.
- Please do not use groundwater or well water in direct.
- The water circuit must be closed circuit.
- Due to continuous improvement, the above specifications may be subject to change without notice.
- This model doesn't equip with a pump.

*6

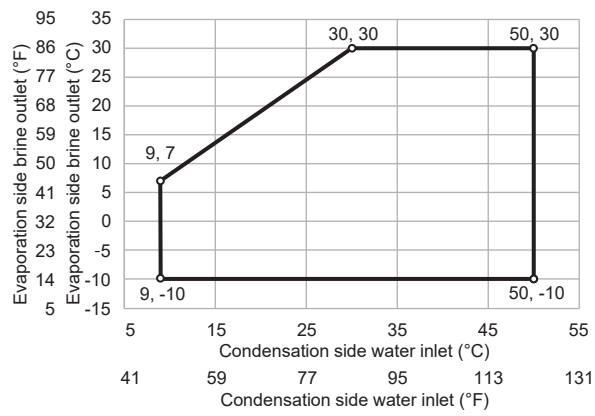

*7

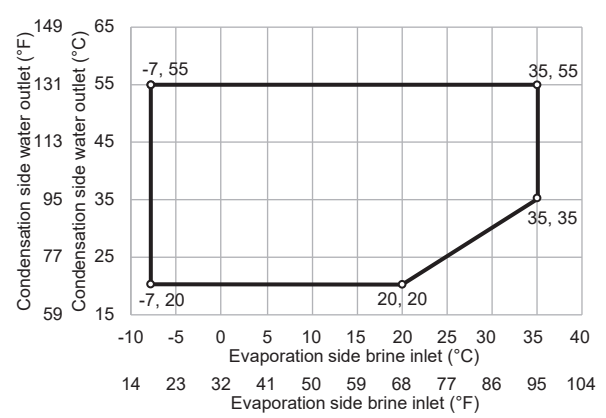

*8 Set the minimum water flow rate on the condensation side water to 16.0m³/h when the evaporation side brine inlet temperature during operation is 15°C(59°F) or higher.

⚠ Warning

- Do not use refrigerant other than the type indicated in the manuals provided with the unit and on the nameplate.
 - Doing so may cause the unit or pipes to burst, or result in explosion or fire during use, repair, or at the time of disposal of the unit.
 - It may also be in violation of applicable laws.
 - MITSUBISHI ELECTRIC CORPORATION cannot be held responsible for malfunctions or accidents resulting from the use of the wrong type of refrigerant.
- Our water-cooled chilling units contain a fluorinated greenhouse gas, R32 (GWP:675).

This GWP value is based on Regulation (EU) No. 517/2014 from IPCC 4th edition. In case of Regulation (EU) No. 626/2011 from IPCC 3rd edition, this is R32 (GWP:550).

MITSUBISHI ELECTRIC CORPORATION

www.MitsubishiElectric.com